

## Star Teck Extreme Director™ (STED) – Teck Cable Fittings

---




Install fitting into enclosure



---

Insert cable & tighten (as usual)

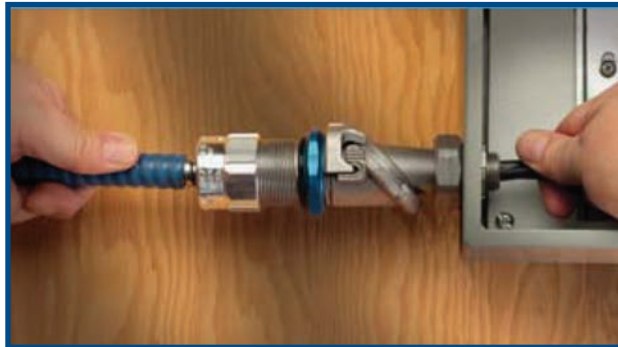

---

Rotate fitting to desired angle



---


**Warning:**

Always ensure that the system is de-energized before performing any installation.

## Star Teck Extreme Director™ (STED) – Teck Cable Fittings



### Assembly:

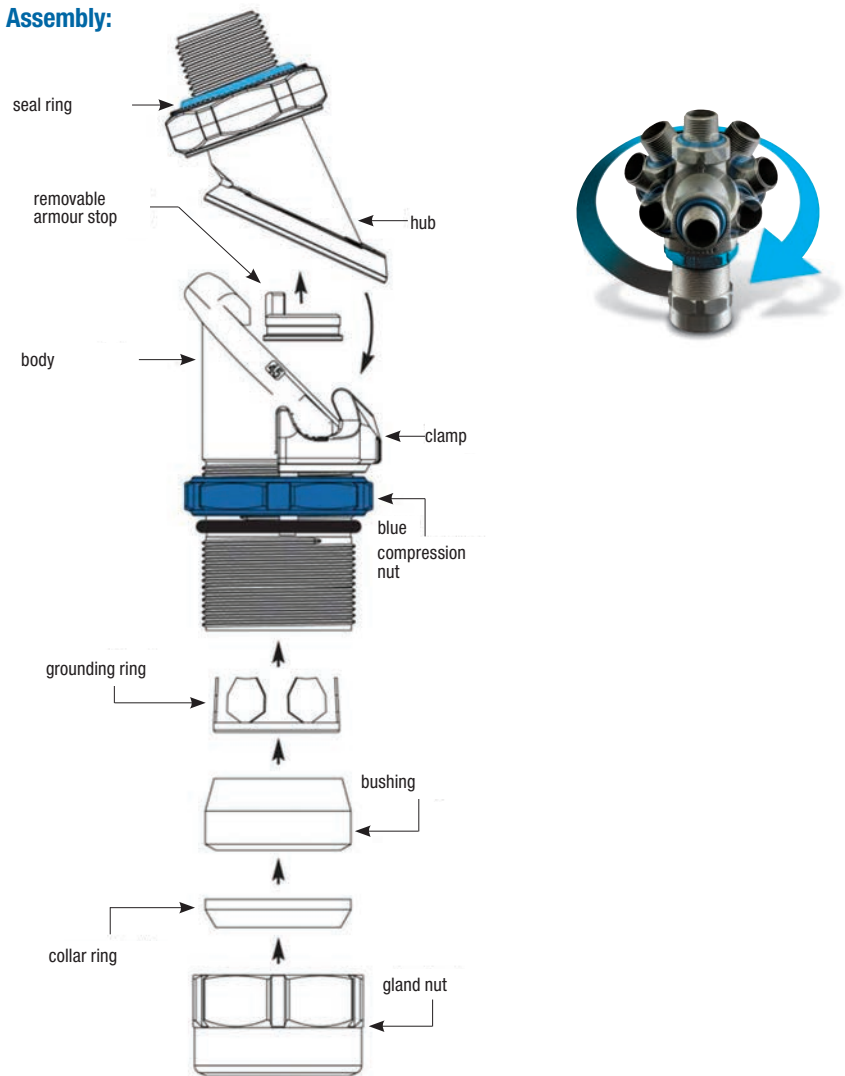

Cat. No.	Hub Size (in.)	Gland Torque (lb.-in.)	Range Over Jacket (in.)		Range Over Armour (in.)		Throat Dia. (Min. in.)		Overall (in.)
			min.	max.	min.	max.	With Armour Stop	Without Armour Stop	
<b>STED050</b>	1/2	450	0.600	0.885	0.520	0.795	0.505	0.617	5.375
<b>STED075</b>	3/4	600	0.860	1.205	0.780	1.125	0.645	0.819	5.875

**Specifications:** Type HLA. CSA Certified Class I, Division 2; Class II, Groups E, F and G, Class III Enclosure Types 4, 4X; Ex e II, IP66.

Type 6 UL listed.

For use with jacketed teck cable, jacketed corrugated metal-clad cable (ACWU) or metal-clad cable (MC). Aluminum or steel armour.